


GRAVITY-DOSED
SEPTIC / PUMP TANK SPECIFICATIONS
(No Scale)

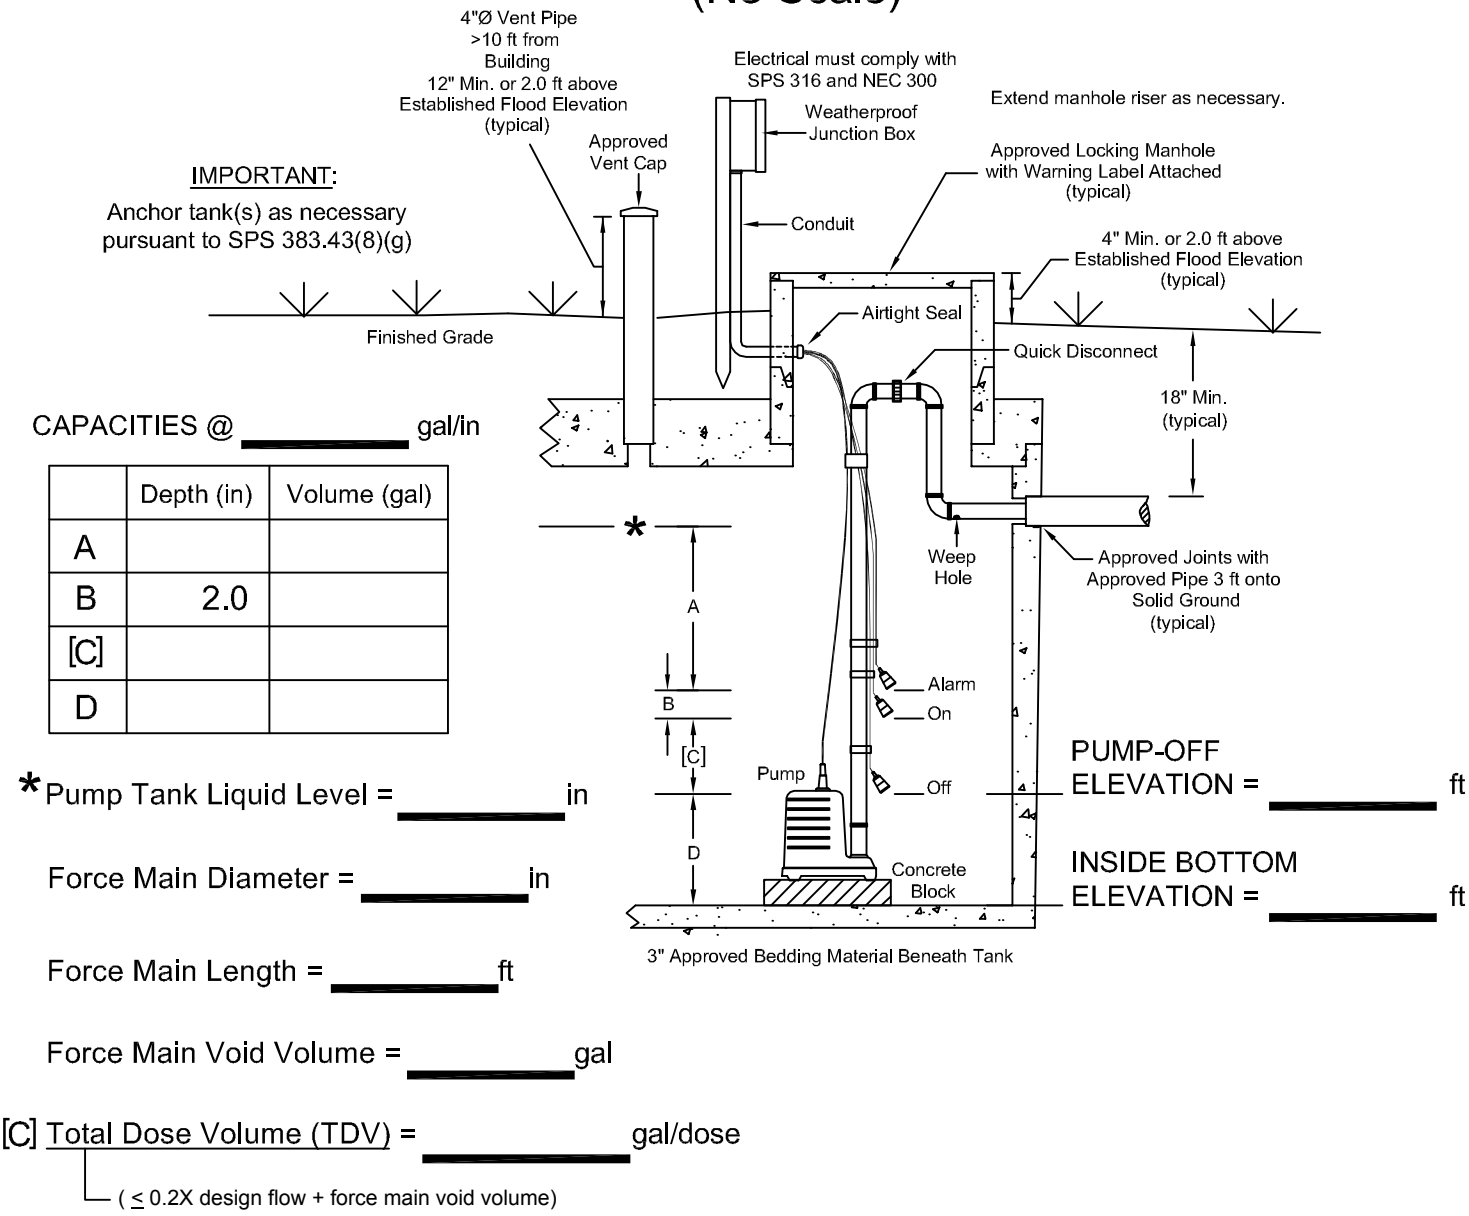

PUMP TANK:

Volume = _____ gal

Manufacturer: _____

Pump Manufacturer: _____

Pump Model: _____ (See attached pump curve.)

Controls/Alarm Manufacturer: _____

Controls/Alarm Model: _____

Float switches containing mercury are prohibited.

SEPTIC TANK(S):

Total Volume = _____ gal

Manufacturer(s): _____

Install approved effluent filter at the septic tank outlet immediately upstream of the pump tank inlet.

Filter Manufacturer: _____

Filter Model: _____